
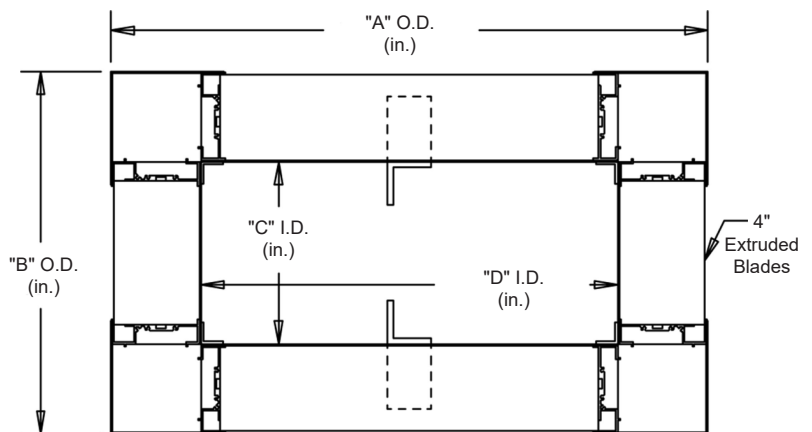
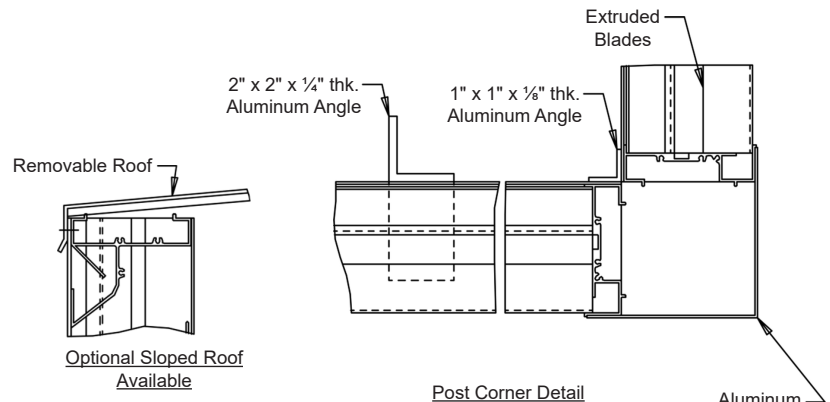


MODEL SPH-22-F

Penthouse Louver • 4" Blade Width • Stationary Straight Blades • Post Corner • Extruded Aluminum

Interior Fastening Installation

ANGLES - All corners and intermediate to extend from roof into curb.

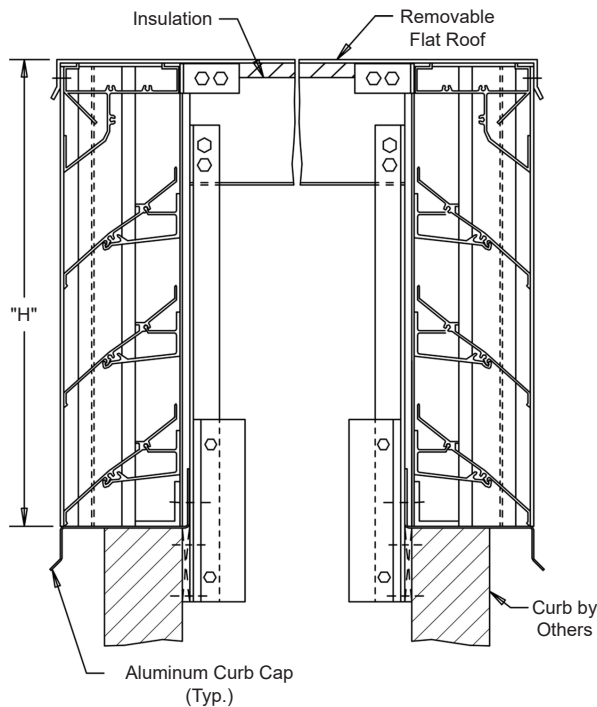

Continuous angle at the four corners and intermediate as required.

Standard Materials and Construction

MATERIAL: .081" thick (nominal) or .125" thick (nominal) extruded aluminum, 6063-T52/T6 alloy, with reinforcing rib bosses.

ROOF: .060" thick (nominal) sheet aluminum removable roof, reinforced with aluminum bracing where required to take a snow load of 40 lbs./sq.ft., plus a required safety factor.

SCREENS: (When indicated)
Bird Screen - 1/2" square mesh, 19 GA. galvanized steel, on interior.

INSULATION: Underside of roof is lined with 1/2" thick insulation.


NOTES: Penthouse dimensions "A" or "B" exceeding 84" shall be shipped in sections for field assembly by others.

| | | | | | | | | | | | | |
|----------------------|-----|---|---|---|---|-------|---------|---------|----------|------|--|------------|
| | | | | | | | | | | | | |
| | | | | | | | | | | | | |
| Item # | Qty | A | B | C | D | H | Mullion | Type | Location | | | |
| Penthouse Dimensions | | | | | | | | Screens | | | | Union Made |
| Arch. / Eng. : | | | | | | EDR: | | ECN: | | Job: | | |
| Contractor: | | | | | | | | | | | | |
| Project: | | | | | | Date: | | DWN: | | DWG: | | |

MODEL SPH-22-F

Penthouse Louver • 4" Blade Width • Stationary Straight Blades • Post Corner • Extruded Aluminum

Exterior Fastening Installation

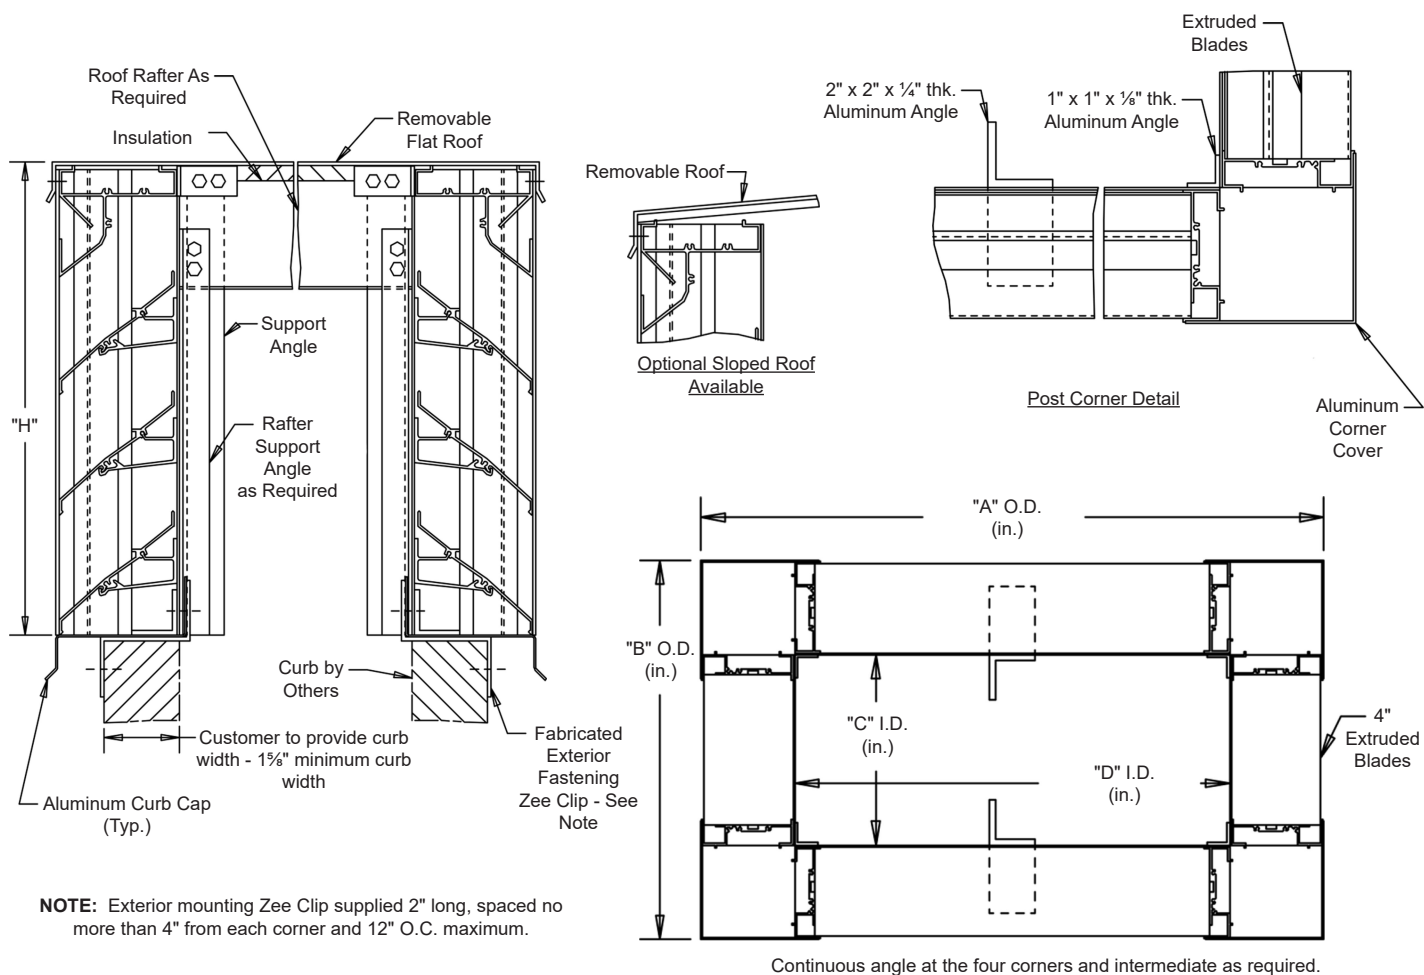

Standard Materials and Construction


MATERIAL: .081" thick (nominal) or .125" thick (nominal) extruded aluminum, 6063-T52/T6 alloy, with reinforcing rib bosses.

ROOF: .060" thick (nominal) sheet aluminum removable roof, reinforced with aluminum bracing where required to take a snow load of 40 lbs./sq.ft., plus a required safety factor.

SCREENS: (When indicated)
Bird Screen - 1/2" square mesh, 19 GA. galvanized steel, on interior.

INSULATION: Underside of roof is lined with 1/2" thick insulation.

NOTES: Penthouse dimensions "A" or "B" exceeding 84" shall be shipped in sections for field assembly by others.

| | | | | | | | | | | | | |
|----------------|-----|----------------------|---|---|---|-------|---------|---------|----------|------|-------------------|---|
| | | | | | | | | | | | |  |
| | | | | | | | | | | | | |
| Item # | Qty | A | B | C | D | H | Mullion | Type | Location | | <u>Union Made</u> | |
| | | Penthouse Dimensions | | | | | | Screens | | | | |
| Arch. / Eng. : | | | | | | EDR: | | ECN: | | Job: | | |
| Contractor: | | | | | | | | | | | | |
| Project: | | | | | | Date: | | DWN: | | DWG: | | |